


REVISION No. 9

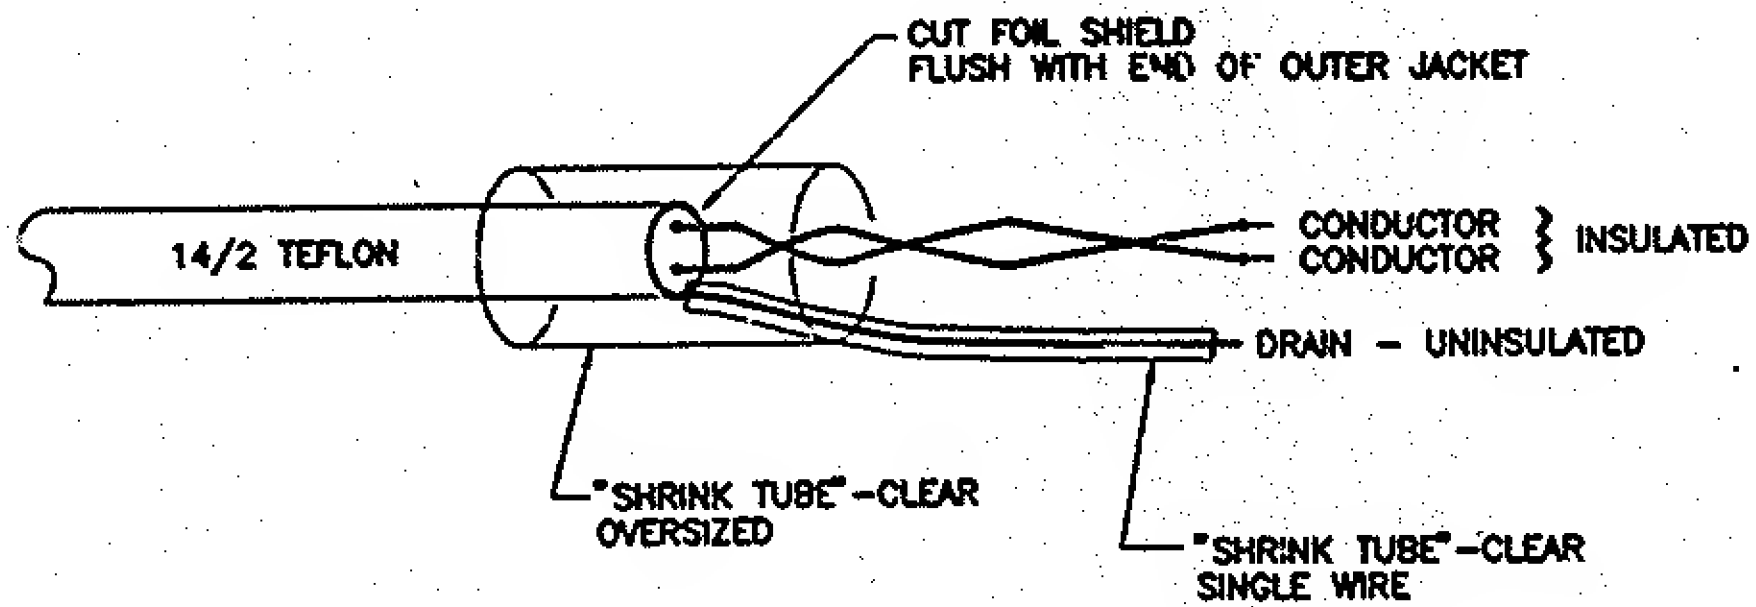

DETAIL "A" - TYPICAL SHIELD/DRAIN INSULATING METHOD

NOTES:

1. FOR LEGEND, ABBREVIATIONS & GENERAL NOTES, SEE DWG'S E-1 AND E-2.
2. ALL SHIELDS SHALL BE ISOLATED FROM GROUND. APPROVED "SHRINK" TUBING SHALL BE USED ON ALL DRAIN CONDUCTORS. SEE DETAIL "A" (ON THIS DWG).
3. FOR NTC-S8 ENCLOSURE LOCATION, SEE DWG E-26.
4. CONTRACTOR SHALL SHAPE, TEST AND LABEL ALL CABLES. FINAL CONNECTION SHALL BE MADE BY CONTRACTOR IN THE PRESENCE AND UNDER THE DIRECT SUPERVISION OF THE ENGINEER.

LEGEND

21UP5	#14 AWG
21DN5	21 - 1
	UP - 1
	DN - 1
	5 - 1
	TB2 - 1
	(+)
	(-)
	(R)
	(B)
	(S)
	2

